

SEE OWNER'S MANUAL FOR CALIBRATION PROCEDURE

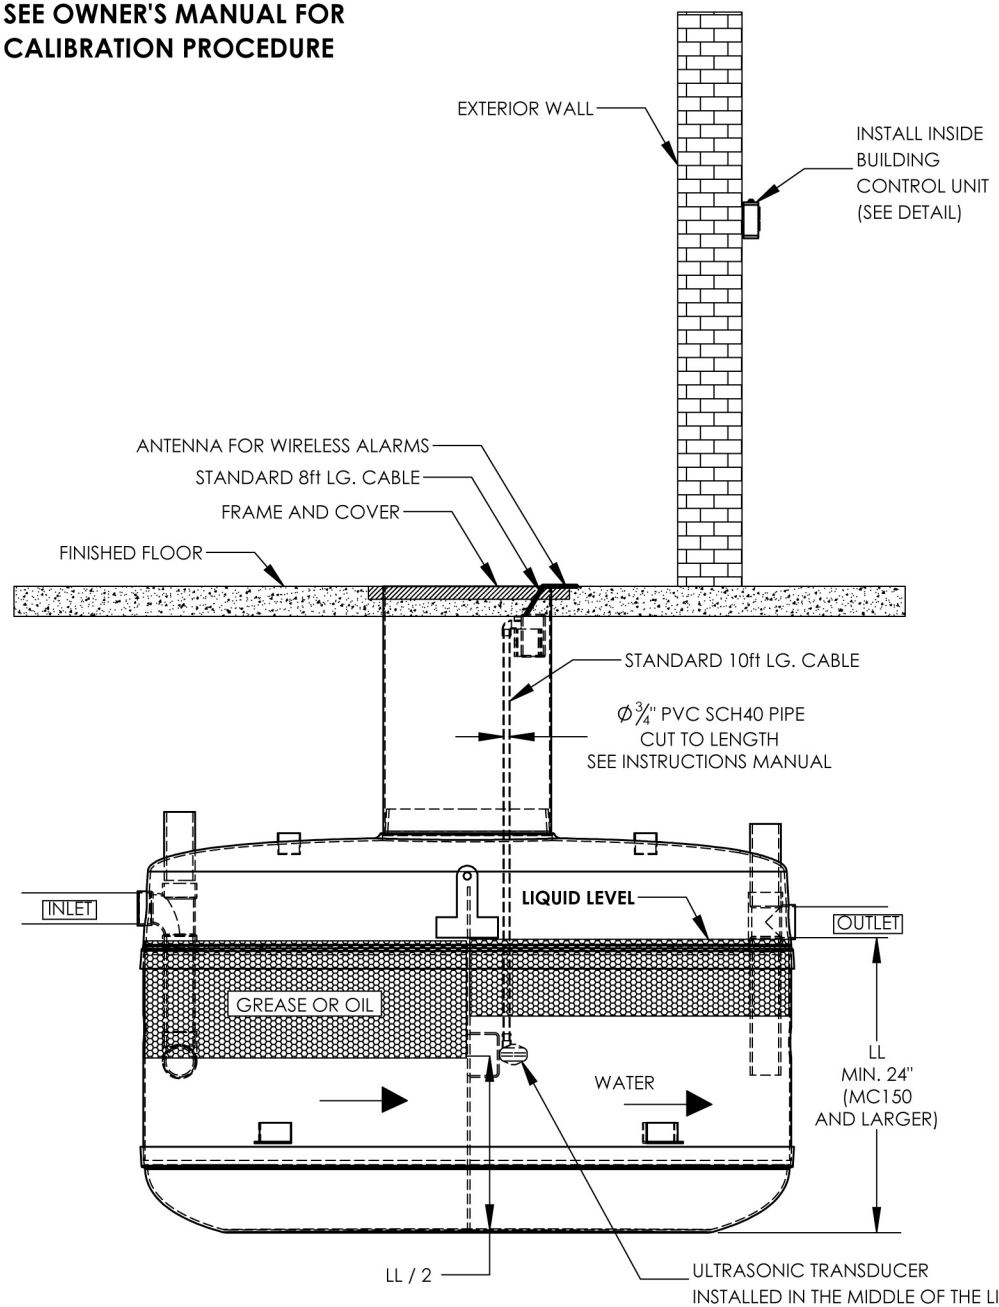

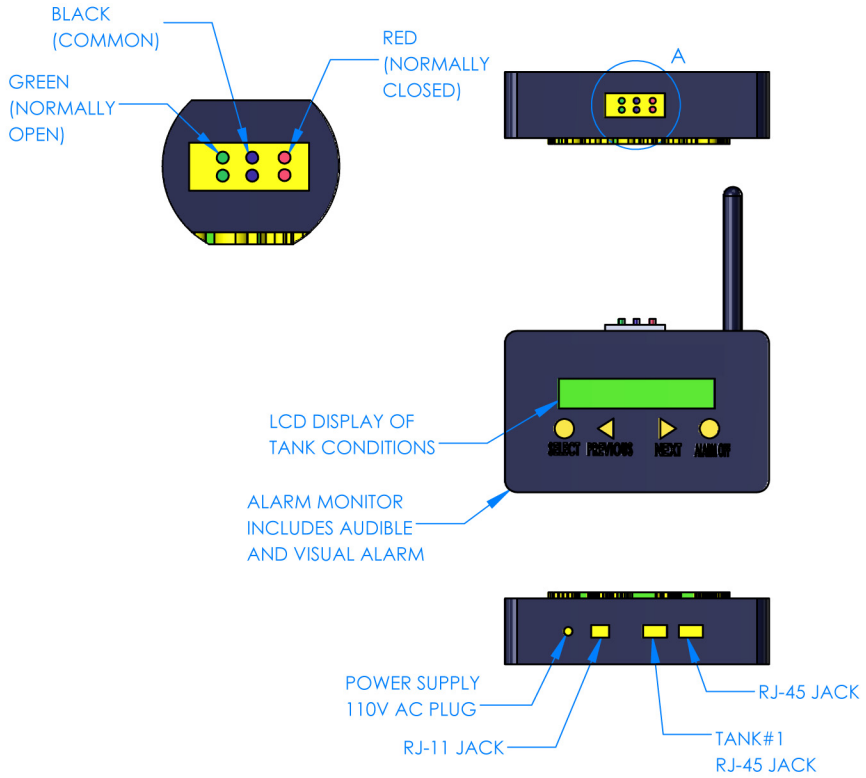

PLUG TRANSDUCER CABLE INTO TANK #1 RJ-45 JACK

SKU GW-400

1. TANKS INSTALLED IN SERIES (EX. GMC 2000(2)) WILL HAVE ALARM INSTALLED IN THE FIRST TANK OUTLET SIDE
2. SINGLE TANKS (WITH BAFFLE) WILL HAVE ALARM INSTALLED ON THE INLET SIDE (BOTH INLET AND OUTLET INSTALLATION IS ALLOWED BUT GT RECOMMENDS INLET)

ALARM IS SHOWN TO BE INSTALLED ON OUTLET SIDE OF TANK

DWG. TITLE: GREASEWATCH 4 WIRELESS ALARM OUTLET SIDE INSTALLATION			
PROJECT:			
SIZE A	DRAWING NOT TO SCALE	DWG #: 21-5486-S	REV. 1

DrainNet