
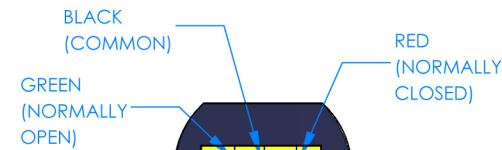


**SEE OWNER'S MANUAL FOR
CALIBRATION PROCEDURE**

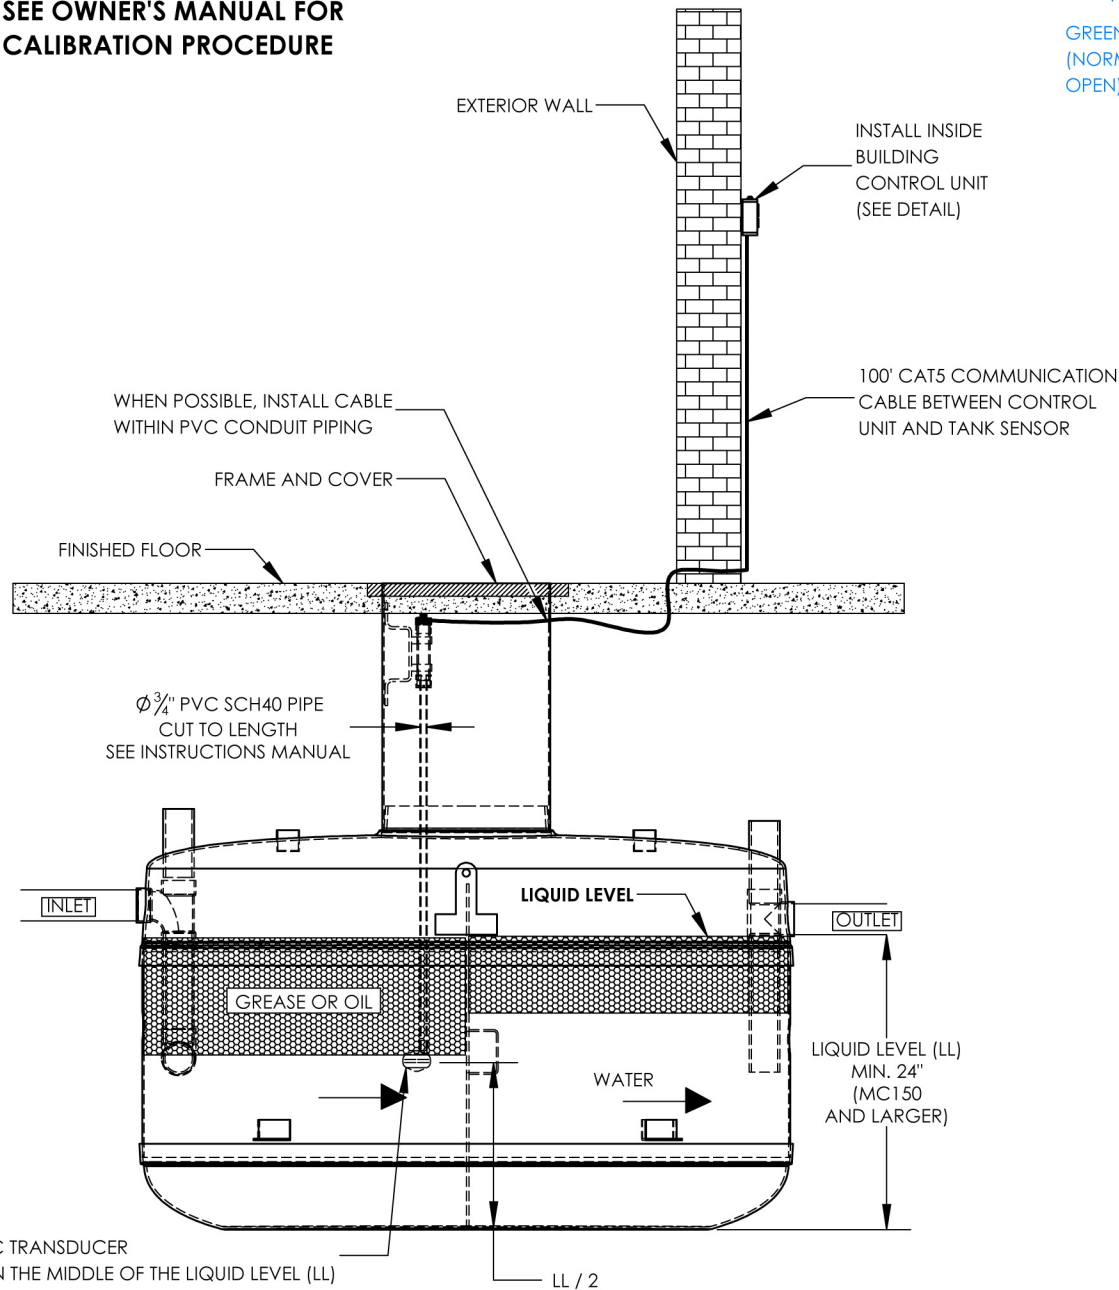

DETAIL A
SCALE 1 : 2

BUILDING AUTOMATION
ALARM OUTPUT

LCD DISPLAY OF
TANK CONDITIONS

ALARM MONITOR
INCLUDES AUDIBLE
AND VISUAL ALARM



CONTROL UNIT

POWER SUPPLY
110V AC PLUG

RJ-11 JACK



TANK#1
RJ-45 JACK

PLUG TRANSDUCER CABLE INTO TANK #1 RJ-45 JACK

ULTRASONIC TRANSDUCER
INSTALLED IN THE MIDDLE OF THE LIQUID LEVEL (LL)

1. TANKS INSTALLED IN SERIES (EX. GMC 2000(2)) WILL HAVE ALARM INSTALLED IN THE FIRST TANK OUTLET SIDE
2. SINGLE TANKS (WITH BAFFLE) WILL HAVE ALARM INSTALLED ON THE INLET SIDE (BOTH INLET AND OUTLET INSTALLATION IS ALLOWED BUT GT RECOMMENDS INLET)

ALARM IS SHOWN TO BE INSTALLED
ON INLET SIDE OF TANK

Product Code: GW-200

DWG. TITLE: WIRED
ALARM G2 INLET SIDE
INSTALLATION

PROJECT:

SIZE
A

DRAWING NOT TO SCALE

DraⁱⁿNet
TECHNOLOGIES

DWG #: **21-5527-S**

REV. 0